




0.191

## EU Type Examination Certificate CML 20ATEX3018X Issue 0

- 1 Equipment intended for use in Potentially Explosive Atmospheres Directive 2014/34/EU
- 2 Equipment **LifEx-ME, LifEx-MN and LifEx-MT series of linear lighting fixtures**
- 3 Manufacturer **Cortem S.p.A.**
- 4 Address **Via Aquileia 10  
34070 Villesse  
(GO)  
Italy**
- 5 The equipment is specified in the description of this certificate and the documents to which it refers.
- 6 CML B.V., Chamber of Commerce No 6738671, Hoogoorddreef 15, Amsterdam, 1101 BA, The Netherlands, Notified Body Number 2776, in accordance with Article 17 of Directive 2014/34/EU of the European Parliament and of the Council, dated 26 February 2014, certifies that this equipment has been found to comply with the Essential Health and Safety Requirements relating to the design and construction of equipment intended for use in potentially explosive atmospheres given in Annex II to the Directive.  
The examination and test results are recorded in the confidential reports listed in Section 12.
- 7 If an 'X' suffix appears after the certificate number, it indicates that the equipment is subject to conditions of safe use (affecting correct installation or safe use). These are specified in Section 14.
- 8 This EU Type Examination certificate relates only to the design and construction of the specified equipment or component. Further requirements of Directive 2014/34/EU Article 13 apply to the manufacture of the equipment or component and are separately certified.
- 9 Compliance with the Essential Health and Safety Requirements, with the exception of those listed in the confidential report, has been demonstrated through compliance with the following documents:  
EN IEC 60079-0:2018  
EN 60079-1:2014  
EN 60079-7:2015  
EN 60079-18:2015  
EN 60079-31:2014

- 10 The equipment shall be marked with the following:

LifEx-ME



II 2 G D

Ex db eb mb IIC T.. Gb

Ex tb IIIC T...°C Db

IP66

Ta=\* see annex

LifEx-MN and LifEx-MT



II 2 D

Ex tb IIIC T...°C Db

IP66

Ta=\* see annex



## 11 Description

The LifEx is a range of linear LED lighting fixtures that are available in three different configurations for different applications, designated as the LifEx-ME, LifEx-MT and LifEx-MN.

### LifEx-ME

The LifEx-ME version has an Equipment Protection Level of EPL Gb and Db and utilises types of protection increased safety (eb) and dust protection by enclosure (tb), along with encapsulation (mb) for the light source and flameproof (db) for the driver.

It is constructed from an aluminium enclosure, with either a glass or polycarbonate lens and with optional polycarbonate diffuser.

### LifEx-MN

The LifEx-MN version has an Equipment Protection Level of EPL Gc and Db and utilises types of protection increased safety (ec) and dust protection by enclosure (tb).

It is constructed from an aluminium enclosure, with polycarbonate diffuser and/or with optional glass or polycarbonate lens.

### LifEx-MT

The LifEx-MT versions has an Equipment Protection Level of EPL Db and utilises types of protection dust protection by enclosure (tb).

It is constructed from an aluminium enclosure, with polycarbonate diffuser and/or with optional glass or polycarbonate lens.

### Design Options

Every configuration is available in lengths ranging from 300 mm to 1500 mm, and power ratings up to a maximum of 105W of nominal power.

The LifEx can be used in only normal service, in only emergency service or in normal and emergency service.

The minimum ambient temperature for the range is:

- -60°C for versions without battery
- -20°C for versions with battery

The range is available with the following maximum ambient temperatures:



CML 20ATEX3018X  
Issue 0

	<b>With glass lens and with/without polycarbonate diffuser</b>	<b>With Polycarbonate lens and with/without polycarbonate diffuser</b>	<b>Without lens polycarbonate diffuser only</b>
LifEx-M... 0310	+60°C	+60°C	+60°C
LifEx-M... 0315	+60°C	+60°C	+60°C
LifEx-M... 0615	+60°C	+60°C	+60°C
LifEx-M... 0630	+60°C	+50°C	+60°C
LifEx-M... 0645	+57°C	+47°C	+60°C
LifEx-M... 0660	+47°C	Configuration not available	+58°C
LifEx-M... 1230	+60°C	+60°C	+60°C
LifEx-M... 1260	+60°C	+50°C	+60°C
LifEx-M... 1290	+60°C	+40°C	+60°C
LifEx-M... 12120	+54°C	Configuration not available	+60°C
LifEx-M... 1590	+60°C	+40°C	+60°C

**Table 1: Maximum Ambient Temperatures**

The following tables provide the Temperature Class (EPL Gb) and Maximum Surface Temperature (EPL Db) for each LifEx type, with the following notes:

- The LifEx-MN with an ambient temperature greater than 50°C is T5 or T4. T6 is not included.
- The Temperature Class (EPL Gb) and Maximum Surface Temperature (EPL Db) in the tables below are not applicable when the ambient temperature is not permitted in the above maximum ambient temperature range table.

(For example, the LifEx-M...0660 is not permitted with polycarbonate lens, therefore the Temperature Class (EPL Gb) and Maximum Surface Temperature (EPL Db) for this version in tables 2 and 3 are not applicable)



**CML 20ATEX3018X  
Issue 0**

	<b>Temperature Class (EPL Gb and Gc) and Maximum Surface Temperature (EPL Db)</b>													
	<b>Based on ambient temperature</b>													
	40°C		45°C		47°C		50°C		54°C		57°C		60°C	
	EPL Db	EPL Gb/Gc	EPL Db	EPL Gb/Gc	EPL Db	EPL Gb/Gc	EPL Db	EPL Gb/Gc	EPL Db	EPL Gb/Gc	EPL Db	EPL Gb/Gc	EPL Db	EPL Gb/Gc
LifEx-M...0310	T56°C	T6	T56°C	T6	T58°C	T6	T61°C	T6	T65°C	T6	T68°C	T6	T71°C	T6
LifEx-M...0315	T56°C	T6	T56°C	T6	T58°C	T6	T61°C	T6	T65°C	T6	T68°C	T6	T71°C	T6
LifEx-M...0615	T56°C	T6	T56°C	T6	T58°C	T6	T61°C	T6	T65°C	T6	T68°C	T6	T71°C	T6
LifEx-M...0630	T69°C	T6	T69°C	T5	T71°C	T5	T74°C	T5	T78°C	T5	T81°C	T4	T84°C	T4
LifEx-M...0645	T72°C	T5	T72°C	T5	T74°C	T5	T77°C	T5	T81°C	T4	T84°C	T4	T87°C	T4
LifEx-M...0660	T77°C	T5	T77°C	T4	T79°C	T4	T82°C	T4	T86°C	T4	T89°C	T4	T92°C	T4
LifEx-M...1230	T58°C	T6	T58°C	T6	T60°C	T6	T63°C	T6	T67°C	T6	T70°C	T6	T73°C	T6
LifEx-M...1260	T67°C	T6	T67°C	T5	T69°C	T5	T72°C	T5	T76°C	T5	T79°C	T4	T82°C	T4
LifEx-M...1290	T72°C	T5	T72°C	T5	T74°C	T4	T77°C	T4	T81°C	T4	T84°C	T4	T87°C	T4
LifEx-M...12120	T75°C	T5	T75°C	T4	T77°C	T4	T80°C	T4	T84°C	T4	T87°C	T4	T90°C	T4
LifEx-M...1590	T72°C	T5	T72°C	T5	T74°C	T4	T77°C	T4	T81°C	T4	T84°C	T4	T87°C	T4

**Table 2: Temperature Class (EPL Gb) and Maximum Surface Temperature (EPL Db) for LifEx types with glass/polycarbonate lens and with polycarbonate diffuser**

	<b>Temperature Class (EPL Gb) and Maximum Surface Temperature (EPL Db)</b>													
	<b>Based on ambient temperature</b>													
	40°C		45°C		47°C		50°C		54°C		57°C		60°C	
	EPL Db	EPL Gb	EPL Db	EPL Gb	EPL Db	EPL Gb	EPL Db	EPL Gb	EPL Db	EPL Gb	EPL Db	EPL Gb	EPL Db	EPL Gb
LifEx-M...0310	T62°C	T6	T62°C	T6	T64°C	T6	T67°C	T6	T71°C	T6	T74°C	T6	T77°C	T6
LifEx-M...0315	T62°C	T6	T62°C	T6	T64°C	T6	T67°C	T6	T71°C	T6	T74°C	T6	T77°C	T6
LifEx-M...0615	T62°C	T6	T62°C	T6	T64°C	T6	T67°C	T6	T71°C	T6	T74°C	T6	T77°C	T6
LifEx-M...0630	T85°C	T6	T85°C	T5	T87°C	T5	T90°C	T5	T94°C	T5	T97°C	T4	T100°C	T4
LifEx-M...0645	T88°C	T6	T88°C	T5	T90°C	T5	T93°C	T5	T97°C	T4	T100°C	T4	T103°C	T4
LifEx-M...0660	T100°C	T6	T100°C	T4	T102°C	T4	T105°C	T4	T109°C	T4	T112°C	T4	T115°C	T4
LifEx-M...1230	T65°C	T6	T65°C	T6	T67°C	T6	T70°C	T6	T74°C	T6	T77°C	T6	T80°C	T6
LifEx-M...1260	T85°C	T6	T85°C	T5	T87°C	T5	T90°C	T5	T94°C	T5	T97°C	T4	T100°C	T4
LifEx-M...1290	T94°C	T6	T94°C	T5	T96°C	T4	T99°C	T4	T103°C	T4	T106°C	T4	T109°C	T4
LifEx-M...12120	T96°C	T5	T96°C	T4	T98°C	T4	T101°C	T4	T105°C	T4	T108°C	T4	T111°C	T4
LifEx-M...1590	T94°C	T6	T94°C	T5	T96°C	T4	T99°C	T4	T103°C	T4	T106°C	T4	T109°C	T4

**Table 3: Temperature Class (EPL Gb) and Maximum Surface Temperature (EPL Db) for LifEx types with glass/polycarbonate lens and without polycarbonate diffuser**



**CML 20ATEX3018X  
Issue 0**


	<b>Maximum Surface Temperature (EPL Db)</b>						
	<b>Based on ambient temperature</b>						
	40°C	45°C	47°C	50°C	54°C	57°C	60°C
LifEx-M...0310	T56°C	T56°C	T58°C	T61°C	T65°C	T68°C	T71°C
LifEx-M...0315	T56°C	T56°C	T58°C	T61°C	T65°C	T68°C	T71°C
LifEx-M...0615	T56°C	T56°C	T58°C	T61°C	T65°C	T68°C	T71°C
LifEx-M...0630	T69°C	T69°C	T71°C	T74°C	T78°C	T81°C	T84°C
LifEx-M...0645	T72°C	T72°C	T74°C	T77°C	T81°C	T84°C	T87°C
LifEx-M...0660	T77°C	T77°C	T79°C	T82°C	T86°C	T89°C	T92°C
LifEx-M...1230	T58°C	T58°C	T60°C	T63°C	T67°C	T70°C	T73°C
LifEx-M...1260	T67°C	T67°C	T69°C	T72°C	T76°C	T79°C	T82°C
LifEx-M...1290	T72°C	T72°C	T74°C	T77°C	T81°C	T84°C	T87°C
LifEx-M...12120	T75°C	T75°C	T77°C	T80°C	T84°C	T87°C	T90°C
LifEx-M...1590	T72°C	T72°C	T74°C	T77°C	T81°C	T84°C	T87°C

**Table 4: (Applicable to EPL Db only) Maximum Surface Temperature for LifEx types without glass/polycarbonate lens and with polycarbonate diffuser**

The equipment has been separately tested against the requirements of IEC 60529 and it meets IP66. The gaskets on the caps provide the degree of protection.

The equipment uses the following nomenclature:

LifEx- M  -

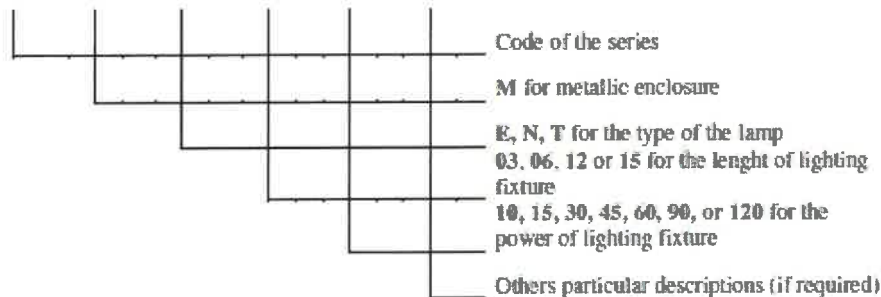

## 12 Certificate history and evaluation reports

Issue	Date	Associated report	Notes
0	06 May 2020	R13027A/00	Prime Issue



**CML 20ATEX3018X**  
**Issue 0**

Note: Drawings that describe the equipment or component are listed in the Annex.

### **13 Conditions of Manufacture**

The following conditions are required of the manufacturing process for compliance with the certification.

- i. Where the product incorporates certified parts or safety critical components the manufacturer shall ensure that any changes to those parts or components do not affect the compliance of the certified product that is the subject of this certificate.
- ii. The Increased safety lighting fixtures LifEx series is to be designed in accordance with general electrical safety standards.
- iii. The routine dielectric test on the Ex de luminaries with applied voltage shall be performed at  $2U + 1000V$  with a minimum value of  $1560V$  ( $U =$  rated voltage of the lamp)
- iv. A routine visual inspection of the encapsulated parts is required, as per Clause 9.1 of IEC 60079-18. There shall be no visible damage or deformation to the encapsulant.

### **14 Specific Conditions of Use (Special Conditions)**

The following conditions relate to safe installation and/or use of the equipment.

- i. Cable entries are provided which have less than 5 threads engaged. Care must be taken to ensure the correct gaskets and washers are used with the cable gland to maintain IP66.
- ii. The equipment uses an external part that is constructed from non-metallic materials, and as such care is to be taken to prevent an electro-static charging hazard. See instruction manual for details.
- iii. For versions with glass window of 4mm thickness without cover, the luminaire must be installed in a location with a low risk of mechanical danger
- iv. The temperature at the entry point may reach up to  $75^{\circ}C$ . Suitably rated cable glands must be used.

## Certificate Annex

**Certificate Number** CML 20ATEX3018X  
**Equipment** LifEx-ME, LifEx-MN and LifEx-MT series of linear lighting fixtures  
**Manufacturer** Cortem S.p.A.



The following documents describe the equipment or component defined in this certificate:

### Issue 0

Drawing No	Sheets	Rev	Approved date	Title
A3-7466	1 to 6	0	06 May 2020	LifEx-M Luminaires
A4-7467	1 to 6	0	06 May 2020	Technical Note